

For Unvented Systems

Depending on the specific details of the installation, additional accessories may be required to comply with water regulations



DXUKIT1

- Expansion vessel with check valve
- 2 Litre vessel set at 3.5 bar




DXUKIT2

- Expansion vessel with check valve
- 2 Litre vessel set at 3.5 bar
- Pressure reducing valve set at 3 bar

Installation Options


Install 1

Pressure is below 4.2 bar and hot water expansion can be accommodated in the pipework

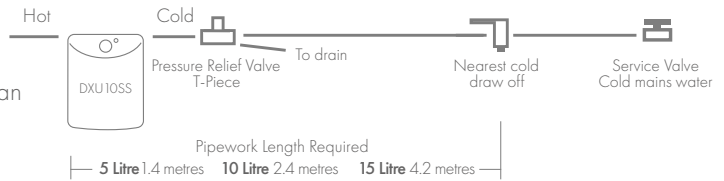

Install 2

Pressure is below 4.2 bar and hot water expansion cannot be accommodated in the pipework

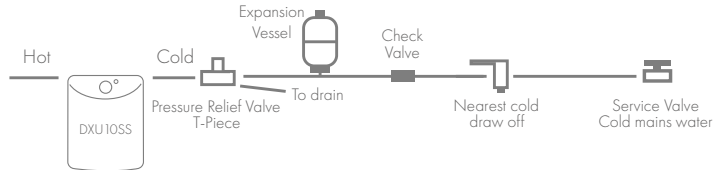

Install 3

Pressure is above 4.2 bar and hot water expansion cannot be accommodated in the pipework

